


## SEWERAGE LINE CHECK VALVE

In accordance with Article 4.20 of the Prince Edward Island Municipal Water and Sewerage Utilities General Rules and Regulations, which have been adopted by this Utility, you are hereby advised that in the case of a building so located that any plumbing fixture in the building is below street level or so as to be affected by a back flow on the sewerage line, such premises shall be provided with a suitable check valve. The complete cost of the check valve shall be borne by the customer. Should you choose not to install a check valve and a backup occurs in your premises you shall be responsible for any damage sustained.

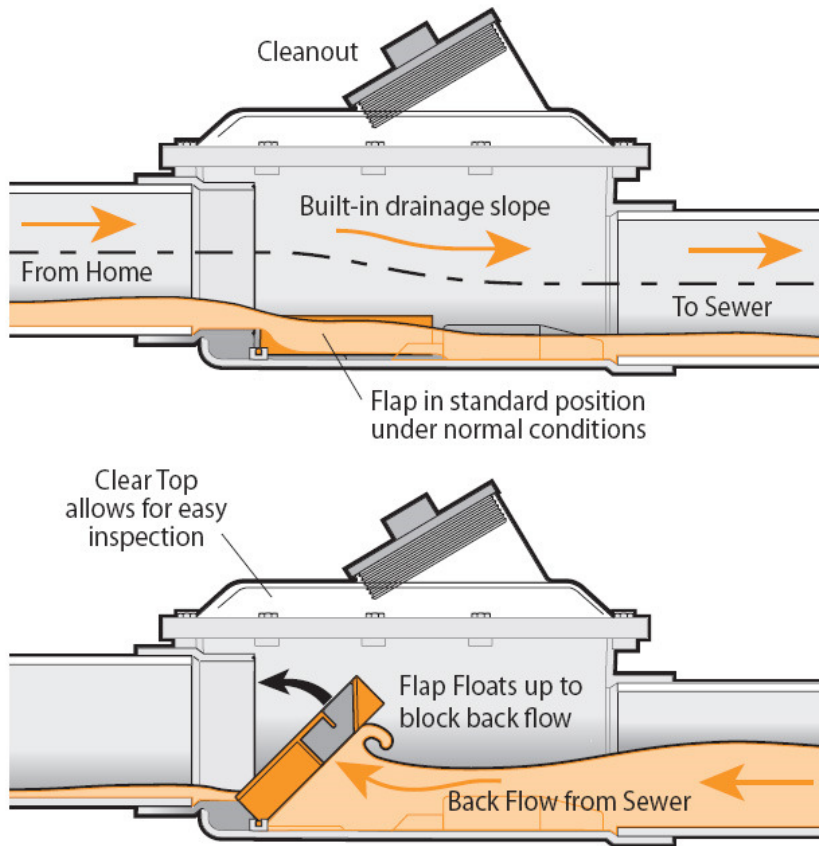

## PROHIBITED SEWERAGE

Customers are reminded that no person shall discharge or cause to be discharged directly or indirectly in the sanitary sewer storm water any surface water, ground water, roof run-off, surface drainage or the like.

